


**MITIGATED NEGATIVE DECLARATION  
OF  
BOARD OF DIRECTORS  
OF THE  
OROSI PUBLIC UTILITY DISTRICT**

**COUNTY CLERK  
COUNTY OF TULARE**

The Project hereafter described will, in our evaluation, have no significant effect on the environment and does not, therefore, require the filing of an Environmental Impact Report.

Board of Directors  
Orosi Public Utility District

By   
Nancy Cerda Serna, President  
Board of Directors

Dated: 14 April 2026

**Project Location:**

See Figure 1, attached.

**Brief Description of Project:**

Well No. 5A Auxiliary Power and Pumps Project

Proposed Project consists of installing a new 500 kW standby diesel generator and three (3) booster pumps at the District's Well 5A site to improve domestic water supply delivery. Proposed Project features (generator, automatic transfer switch, building, pumps and electrical connections) will be constructed above ground at the well site. Construction activities include earthwork, site grading, concrete work and electrical work.

**Reason(s) for Mitigated Negative Declaration finding:**


The Project will result in no adverse long-term environmental impacts. Short-term construction related potential impacts will be mitigated to a less than significant level by use of construction specifications requiring defined mitigation measures.

**Initial Study prepared by:**

Dennis R. Keller, Consulting Civil Engineer for  
Orosi Public Utility District

**Initial Study available at:**

Orosi Public Utility District  
12488 Avenue 416  
Orosi, CA 93247

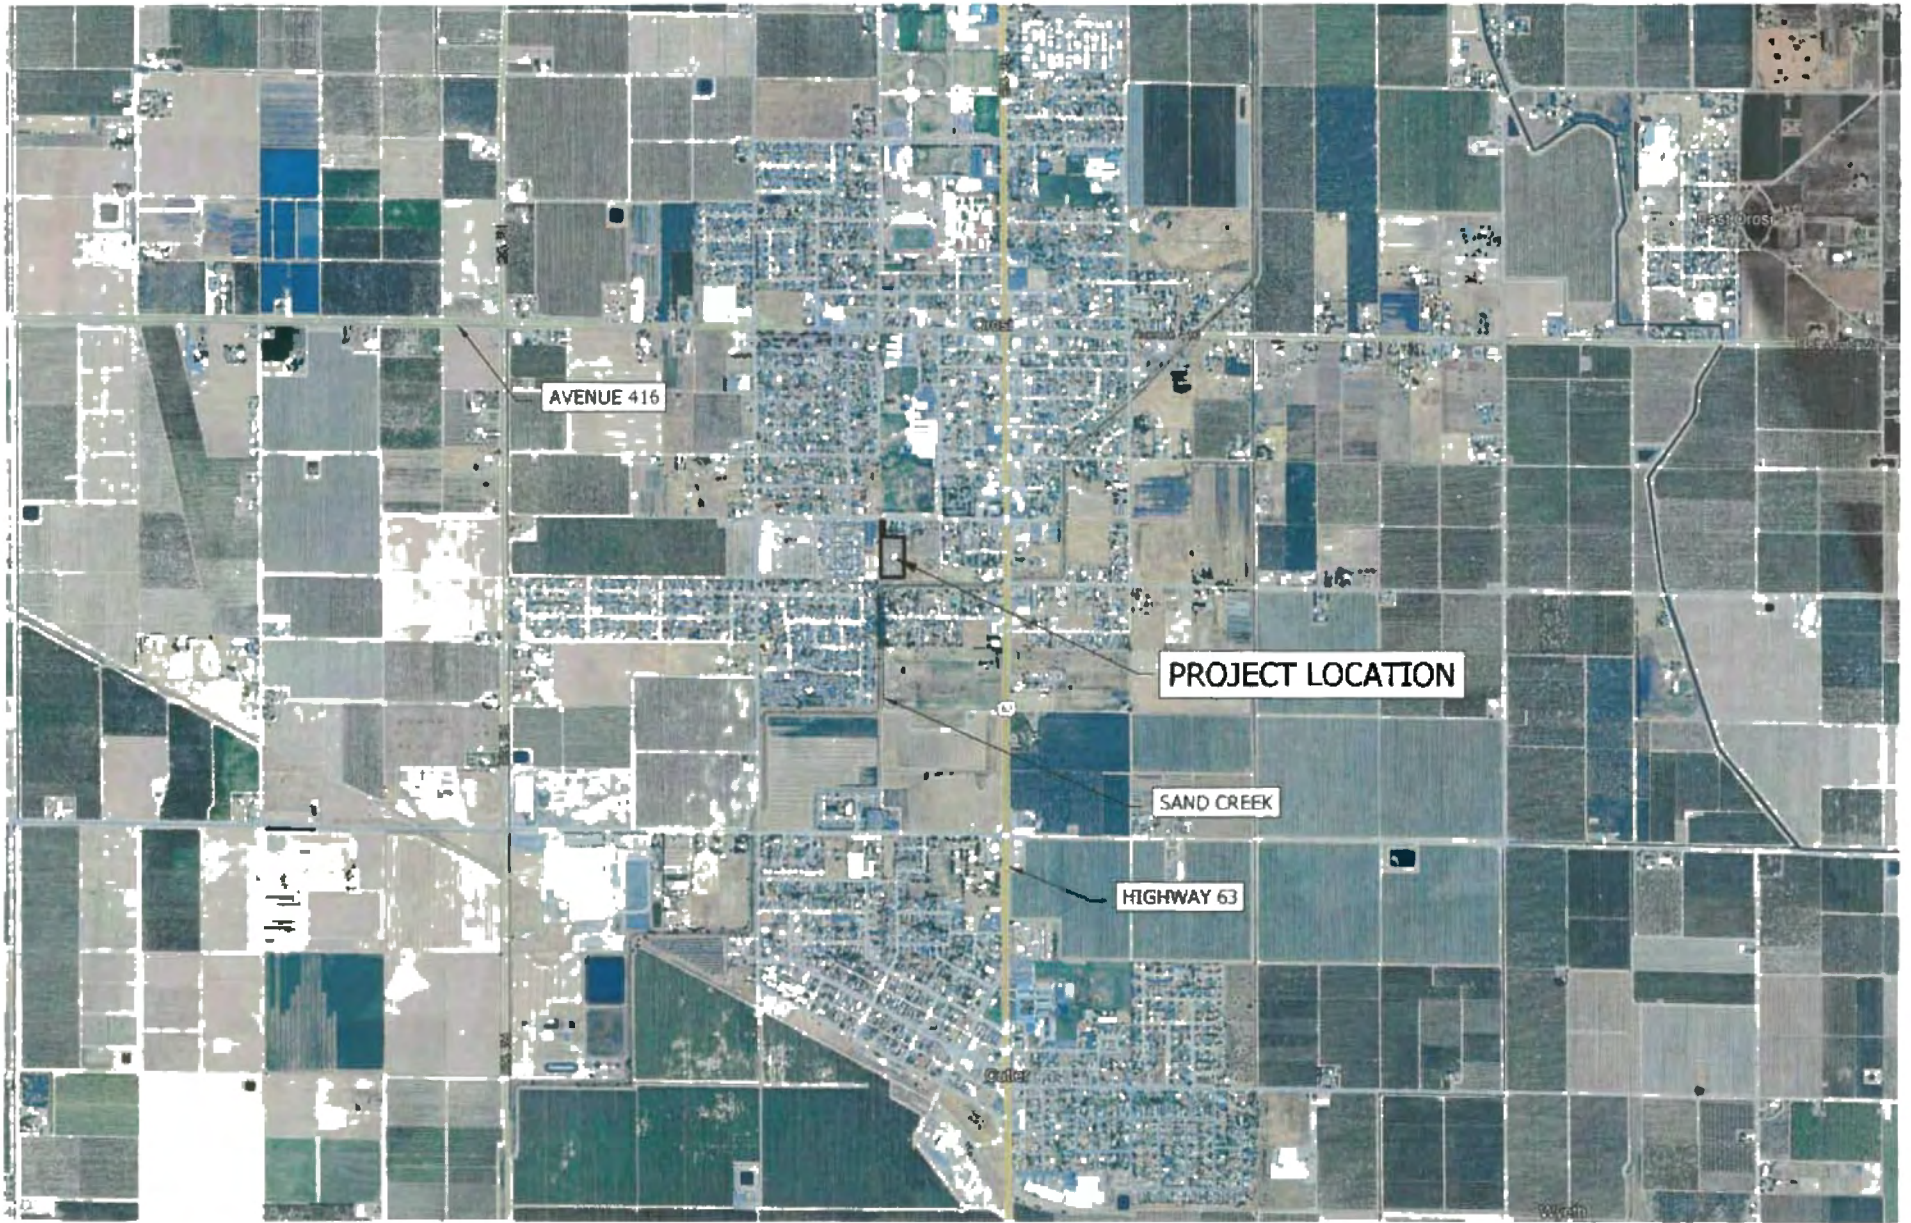

SCALE: 1" = 2,000'

<b>PROJECT LOCATION</b>
<b>WELL NO. 5A AUXILIARY POWER AND PUMPS PROJECT</b>
<b>OROSI PUBLIC UTILITY DISTRICT</b>